




INSTALLATION, OPERATION AND MAINTENANCE INSTRUCTIONS

NexLED - Emergency Bulkhead Luminaires

ATEX & IECEx

Important: Please read these instructions carefully before installing or maintaining this equipment. Good electrical practices should be followed at all times and this data should be used as a guide only.

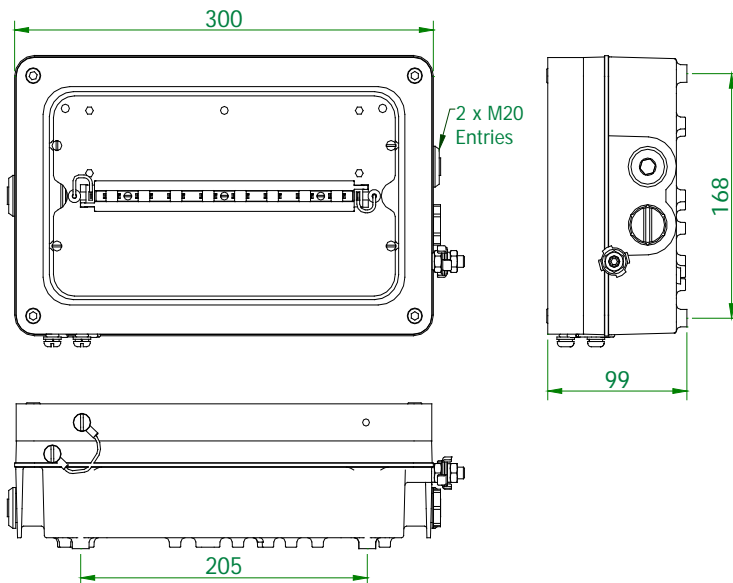

Protection Standards	EN/IEC 60079-0, 60079-7, 60079-11, 60079-18, 61241-1	
ATEX Classification	Group II Category 2 G D	
Area of application	Zone 1 and Zone 21 areas to EN/IEC 60079-10-1 and 60079-10-2.	
Installation	EN60079-14	
Certificate	EC Type Examination Certificate Baseefa04ATEX0245 IECEx Certificate of Conformity IECEx BAS 09.0062	
Equipment Coding	 II 2GD Ex e ib mb IIC T4 Gb -45°C ≤ Ta ≤ +55°C Ex tb IIIC T95°C Db IP66	Standard product -20°C to +55°C Low Temp version down to -45°C Add suffix /LT to Catalogue Code
Ingress Protection	IP66 and IP67 to BS EN 60529	
Laser safety class	Class 1 LED product	
CE Mark	 The CE marking of this product applies to "The Electrical Equipment (Safety) Regulations 1994", "The Electromagnetic Compatibility Regulations 1992", the "Waste Electrical and Electronic Equipment Regulations 2006" and the "Equipment and Protective Systems intended for use in Explosive Atmospheres Regulations 1996". [This legislation is the equivalent in UK law of EC directives 2006/95/EC, 2004/108/EC and 2002/96/EC respectively].	

SPECIAL CONDITIONS FOR SAFE USE

None



1.0 Introduction

The Chalmit NexLED emergency brings to hazardous areas the very latest in lighting technology. It is a compact light source that uses ultra bright light emitting diodes to provide light from mains power. The LEDs are maintenance free and can last up to 80000 hours or more. They are housed in an impact and corrosion resistant marine grade aluminium enclosure with a toughened glass lens. The control gear is electronic with regulated lamp output. The LEDs work equally well at very low temperatures as they do at high and produce a product with very low overall power consumption. When the Nexled is specified for low temperature it should be fitted with a battery pack heater to enable the battery pack to be kept at an optimum temperature for maximum reliability and duration. The LEDs also emit no ultra-violet light and no forward heat.

The product is available with 2 or 8 lamps and an accessory kit is available for exit signs.

Led	2 x 1W	8 x 1W
Voltage range AC	110 - 254V	
Frequency range Hz	50/60/0Hz	
Power Watts 220-254V	6W (16W)	15W (25W)
Current Amps 220-254V	48mA (130mA)	80mA (120mA)
Power Watts 110-130V	6W (16W)	15W (25W)
Current Amps 110-130V	48mA (130mA)	120mA (250mA)

* Figures brackets represent values when heater is in operation

The safety limit for surface temperature (T rating) is +/-10% on the rated voltage. Equipment should not be operated continuously at more than +10/-10% of the rated voltage of the control gear.

Batteries	4.2V 4Ah NiCd (Battery Pack is disconnected for transportation)	
Emergency Duration	90 minutes duration for the 8 Watt and 3 hours duration for the 2 Watt	
Emergency Output	100%	
Power Factor	0.85 minimum	
EMC	EN 61547	EN 55015
Over voltage	400V ac for 1 min	
Looping	The looping current rating is 16A. 4mm ² terminals are standard (6mm ² wiring can be used in the terminals in accordance with the luminaire certificate)	
Tamb Storage	-40°C to +50°C	
Storage	Luminaires are to be stored in cool dry conditions preventing ingress of moisture and condensation.	
LED	The LED used in the Nexled is the latest technology and is a class 1 LED product.	
Fuse and MCB Ratings	Current consumption of an 8 lamp unit is 80mA and for a 2 lamp unit 49mA. It is recommended that for selection of MCB's users should consult the MCB manufacturer. MCB ratings can vary depending on the manufacturer and type and the size of the installation, i.e. impedance of conductors, however type 'C' breakers are usually suitable. The electronic control gear has an inrush current of 12A for less than 1ms on 230V. These figures are worst case with low resistance connections with short cables and low impedance supplies.	

2.0 Storage

Luminaires and control gear boxes are to be stored in cool dry conditions preventing ingress of moisture and condensation. Any specific instructions concerning emergency luminaires must be complied with.

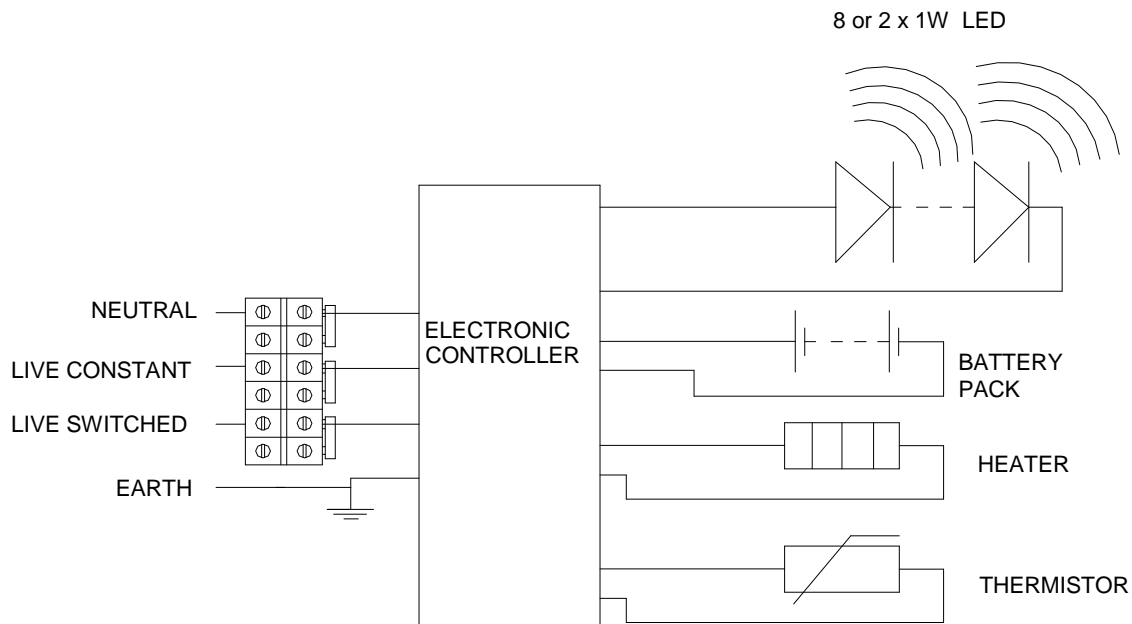


Diagram showing fully specified circuit with optional heater.

3.0 Installation and Safety

3.1 General

There are no health hazards associated with this product whilst in normal use. However, care should be exercised during the following operations. Installation should be carried out in accordance with *EN/IEC 60079-14* or the local hazardous area code of practice, whichever is appropriate, and fitting of specified insulating material to be adhered to where a specific fire resistance rating is required. In the UK the requirements of the '*Health and Safety at Work Act*' must be met.

Handling and electrical work associated with this product to be in accordance with *the 'Manual Handling Operations Regulations'* and *'Electricity at Work Regulations, 1989'*. Your attention is drawn to the paragraphs (i) 'Electrical Supplies', (ii) 'Electrical Fault Finding and Replacement' and (iii) 'Inspection and Maintenance'. The luminaires are class 1 and should be effectively earthed. Certification details on the rating plate must be verified against the application requirements before installation.

The information in this leaflet is correct at the time of publication. The company reserves the right to make specification changes as required.

3.1.1 Use in Combustible Dust Atmospheres

Where the equipment is used in ignitable dust atmospheres reference must be made to the selection and installation standards in order that the equipment is used correctly. In particular this applies to the de-rating of surface temperature for use where dust clouds may be present. Dust layers should not be allowed to accumulate on the surface and good housekeeping is required for safe operation. Dust in layers has the potential to form ignitable clouds and to burn at lower temperatures. Refer to *EN/IEC 60079-10-2*.

3.1.2 Hybrid Mixtures – Gas and Dust

Where hybrid mixtures exist as defined in *EN 1127* as a potentially explosive atmosphere, consideration should be given to verifying that the maximum surface temperature of the luminaire is below the ignition temperature of the hybrid mixture.

3.2 Tools

No 1/2 Philips/Pozidriv/T20 Torx screwdrivers
3mm and 5mm flat blade screwdriver
Spanners for installing cable glands.
Pliers, knife, wire Strippers/cutters.

3.3 Electrical Supplies

The standard unit is rated for a nominal 110V-254V AC 50/60/0Hz. A maximum voltage variation of +6%/-6% on the nominal is expected. (The safety limit for T rating is +10%). The lamp supply is regulated therefore the light output over the supply range is constant.

The battery pack red wire should be the last connection made prior to energising supply power.

3.4 LED Array & Driver

This product is fitted with LED lamps that can last in excess of 80000 hours. Therefore in many applications replacement of the LED array will be unnecessary. If replacement is required ensure mains supplies are isolated before commencing work. Remove the front cover and then remove the LED array and disconnect the cables then remove the Torx head screws. Assembly is the reverse of disassembly 6. The driver and batteries may be replaced, ensure the correct parts are ordered and that the cables are reconnected correctly. Also ensure that the gasket/glass mating surfaces are clean and cables are not trapped.

3.5 Mounting

Luminaires should be installed where access for maintenance is practical and in accordance with any lighting design information provided for the installation. Mounting is by 4 holes in the base of the body casting external to the gasket. These should be secured with lock washers or self-locking nuts and bolts and are accessed by removing the front cover. Any mounting attitude may be used.

3.6 Cabling and Cable Glands

3.6.1 Cables

The maximum conductor size is 6mm². Internal earth point is provided next to the main terminal block. 300/500V cable ratings are adequate and no special internal construction is necessary. The standard looping cable size is up to 6mm². The selection of cable size must be suitable for the fuse rating. Terminals are supplied with suitability for looping. Where looping is used the maximum current is 16A. Terminals are accessed by removing the front cover and LED module. Maximum cable temperature rise is 20°C above ambient.

3.6.2 Cable Glands

The installer and user must take responsibility for the selection of cables, cable glands and seals. Three tapped cable entries are provided, two with a plug and seal suitable for permanent use, the other with a travelling plug not suitable for use in service. Sealing plugs are similarly rated and a tool must be used for their removal. Cable entries are M20x1.5. Cable glands and sealing plugs must have ATEX approval or be certified to EN60079-0. For installation outside the EU suitable cable glands in accordance with IEC 60079-0 will meet the technical requirements.

The cable and gland assembly when installed must maintain a minimum of IP54 rating.

The cable glands must be suitable for the application. Where brass cable glands are used in a corrosive environment, cadmium or nickel plating should be used.

3.8 Emergency Operation

When there is a disruption to the mains supply the Nexled will switch over to battery backup; as there is no difference in light output this will be signalled by one blink at switchover. Following a full discharge, the LEDs will blink periodically as the batteries regenerate.

It is recommend that the battery pack is charged for a 24 hour cycle, then fully discharged and re-charge so that the full duration can be achieved. However if the battery pack has been fully discharged an additional cycle may be required.

3.9 Battery Maintenance

The battery pack is a 4.2V 4Ah NiCad 4 cell pack. Periodic testing allowing full discharge will enable the cells to remain in a healthy condition. Should the battery pack need to be replaced spares may be ordered from Chalmit Lighting. **The battery assembly must be protected from damage and water ingress then removed from any potentially hazardous area as soon as practical.**

The luminaire must not be operated without the battery connected. If the battery is removed and not replaced the control gear supply must be disconnected at the mains terminal block and secured. Care must be taken to connect the positive and negative terminals correctly.

3.9.1 Low temperature operation with battery heater

At temperatures near 0°C ambient the battery heater will switch on. This enables the batteries to be maintained within their optimum temperature range down to -45°C.

4.0 Inspection and Maintenance

Visual inspection should be carried out at a minimum of 12 monthly intervals and more frequently are severe; refer to EN/IEC 60079-17.

4.1 Electrical Fault Finding and Replacement

Any fault finding must be done by a competent electrician with the luminaire isolated and, if carried out with the luminaire in place, under a permit to work. Fault finding is by substitution with known good components.

5.0 Routine Maintenance

Visual tests and checks should be carried out at intervals described by the appropriate regulations, EN 60079-17, and should include the following:

Check that the LEDs are working.

Check for mechanical damage/corrosion.

Check for loose connections including earthing.

Check for undue accumulations of dust or dirt.

Verification of tightness of fixing, glands, blanking plugs etc.

Check for unauthorised modifications.

Check condition of enclosure gasket and fastenings.

Check for any accumulation of moisture.

Periodic inspection of the enclosure seal should be carried out to ensure that the seal is sound.

If the luminaire has been subject to abnormal conditions, for example, severe mechanical impact or chemical spillage, it must be de-energised until it has been inspected by an authorised and competent person. If in doubt, the unit should be returned to Chalmit for examination and, if necessary, replacement.

Before re-assembling, all connections should be checked and any damaged cable replaced.

6.0 Disposal of Material

Any disposal must satisfy the requirements of the WEEE directive [2002/96/EC] and therefore must not be treated as commercial waste. The unit is mainly made from incombustible materials. The control gear contains plastic resin and electronic components. All electrical components may give off noxious fumes if incinerated.

6.1 Battery Disposal



Nickel cadmium batteries are defined as 'controlled waste' under the hazardous waste regulations and the person disposing needs to observe a 'duty of care'.

Batteries can be returned to the manufacturers for recycling. They must be stored and transported safely and any necessary pollution control forms completed prior to transportation. Take care to fully discharge batteries before transporting, or otherwise ensure that there can be no release of stored energy in transit. For further details refer to our Technical Department



To comply with the Waste Electrical and Electronic Equipment directive 2002/96/EC the apparatus cannot be classified as commercial waste and as such must be disposed of or recycled in such a manner as to reduce the environmental impact.

Chalmit Lighting is a leading supplier of Hazardous Area and Marine Lighting products

	<p>CHALMIT LIGHTING PO Box 5575 Glasgow, G52 9AP Scotland</p>	
<p>Telephone: +44 (0) 141 882 5555 Fax: +44 (0) 141 883 3704 Email: info@chalmit.com Web: www.chalmit.com</p>	<p>Registered No: 669157 Registered Office: Mitre House, 160 Aldersgate Street, London, EC1A 4DD</p>	

For technical support, please contact: techsupport@chalmit.com

Note: Chalmit Lighting reserves the right to amend characteristics of our products and all data is for guidance only.



EC-Declaration of conformity
CE-Déclaration de conformité



EG-Konformitätserklärung

The technical basis, with respect to equivalence of
La base technique, en ce qui concerne l'équivalence de
Die technische Grundlage hinsichtlich der Normen
EN 60079-0:2006, 60079-1:2004 to/à/dazu EN 60079-0:2009 and/et/und 60079-1:2007
Area Classification EN 60079-10-1, EN 60079-14 and EN 60079-10-2, EN 61241-14

of compliance with the EHSRs is valid as there are no changes which materially affect the state of technological progress of the product.
en conformité avec les EESS est valide puisqu'il n'y a aucun changement qui affecte matériellement l'état de l'évolution technologique du produit.
zur Erfüllung der GSGA ist gegeben, da keine Änderungen erfolgt sind, die einen Einfluss auf den technischen Stand des Produkts haben.

Terms of the directive: Title and/or No. and date of issue of the standard:
Prescription de la directive: Titre et/ou N° et date d'édition de la norme:
Bestimmungen der Richtlinie: Titel und/oder Nr. sowie Ausgabedatum der Norm:

94/9/EC	Equipment and protective systems intended for use in potentially explosive atmospheres.	EN 60079-0 : 2012 EN 60079-7 : 2007
94/9/CE	Appareils et les systèmes de protection destinés à être utilisés en atmosphères potentiellement explosibles.	EN 60079-11 : 2007 EN 60079-18 : 2004
94/9/EG	Geräte und Schutzsysteme zur bestimmungsgemäßen Verwendung in explosionsfähigen Bereichen.	EN 61241-1 : 2004
2004/108/EC	Electromagnetic compatibility	EN 55015 : 2013
2004/108/CE	Compatibilité électromagnétique	EN 61547 : 2009 +A2 : 2009
2004/108/EG	Elektromagnetische Verträglichkeit	EN 61000-3-2 : 2014
2006/95/EC	Low voltage equipment	EN 60598-1 : 2008
2006/95/CE	Équipements électriques à bas voltage	EN 60529 : 1992
2006/95/EG	Niederspannungsgeräte / -systeme	EN 60598-2-22 : 1998 +A2 : 2008
2002/96/EC	Waste of electrical and electronic equipment	
2002/96/CE	Déchets d'équipements électriques et électroniques	
2002/96/EG	Entsorgung der elektrischen und elektronischen Geräte / Systeme	

2011/65/EU RoHS II Directive

On behalf of the Chalmit, I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms to all technical and regulatory requirements of the above listed directives.

En tant que représentant du fabricant Chalmit, je déclare qu'à la date où les équipements accompagnant cette déclaration sont mis sur le marché, ceux-ci sont conformes à toutes les dispositions réglementaires et techniques des directives énumérées ci-dessus.

Hiermit bestätige ich, im Namen von Chalmit, dass am Tag der Lieferung des Produkts/der Produkte zusammen mit dieser Erklärung das Gerät/die Geräte alle technischen und regulativen Anforderungen der oben aufgeführten Direktiven erfüllt.

Name and Date Mark Poutney 11/11/2014
Nom et Date
Name und Datum

Technical Manager
Directeur technique
Technischer Leiter

Quality Assurance Notification by: **Baseefa Ltd.**
Notification d'assurance qualité par: **1180**
Qualitätssicherungsnotifikation durch:

Quality Management System Accreditation:
Certification du système de gestion de la qualité:
Qualitätsmanagementsystem Akkreditierung:
Certificate No./Certificat N°/Zertifikat Nr.

ISO 9001
by/par/durch
Lloyd's Register
LRQ 4005876